




MODEL: MFDUS ULTRA SLIMFRAME CURTAIN-TYPE FIRE DAMPER VERTICAL 1.5-HOUR RATING



1.5-HOUR RATING:

For use in fire barriers rated for 2 hours or less.



STANDARD CONSTRUCTION:

- Frame:** Roll Formed 22 Ga. Galvanized Steel with Safety Edge. Width and height dimensions available in 1/4" increments.
- Blades:** Roll Formed 24 Ga. Galvanized Steel, Curtain Type.
- Transition:** 20 Ga. Galvanized Steel
- Finish:** Mill Galvanized Standard.

OPTIONS:

- Type-A, Type-B and Type-C
- Fusible link 165°F, 212°F, 286°F
- Vertical application only, not approved for horizontal application
- Sleeve options are 20 Ga., 18 Ga., or 16 Ga. and 12", 14" or 16" long
- Low pressure, medium/high pressure or high pressure
- Microswitch

TYPICAL VERTICAL DAMPER

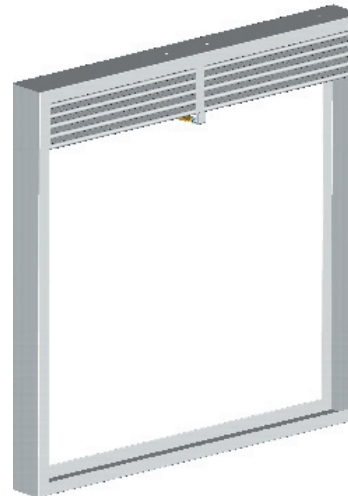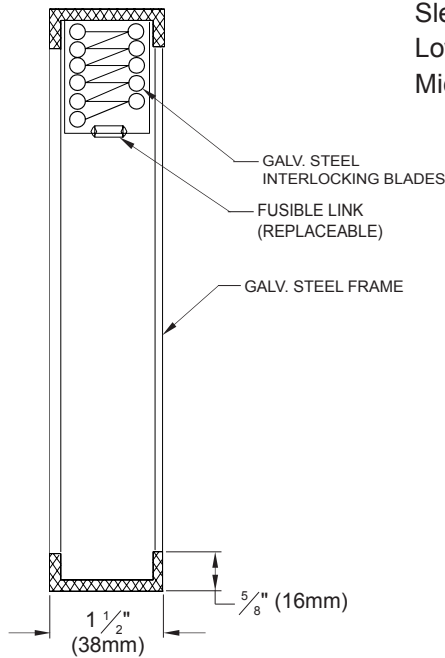


DUCT SIZE LIMITATIONS:

	<u>MIN.</u>	<u>MAX. SINGLE SECTION</u>
Vertical A	4.25"W x 4.00"H	48.25"W x 48.25"H
Vertical B	4.25"W x 2.00"H	48.25"W x 43.25"H
Vertical C	5.25" DIA.	47.25"W x 42.25"H


Project:
Location:
Architect:
Engineer:

Contractor:
Address:
P.O. Number:
Date:

MODEL STYLES

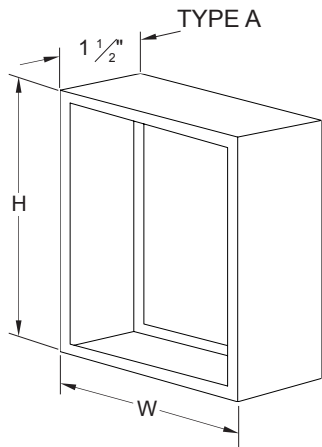


TYPE A

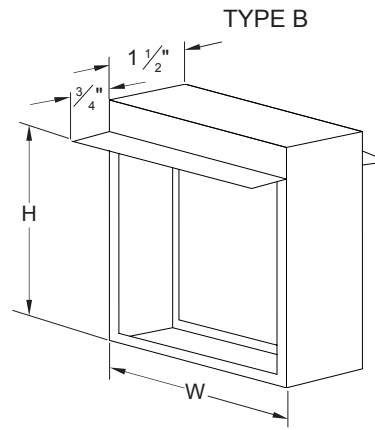


TYPE B


TYPE C
SQUARE TRANSITION

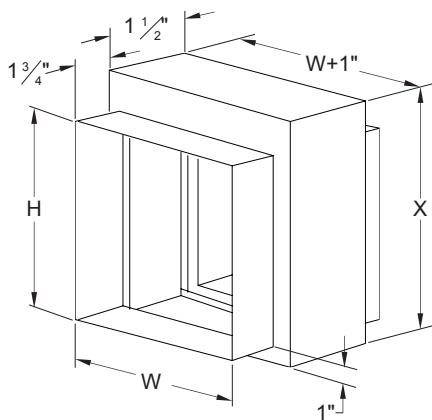


TYPE C
OVAL TRANSITION

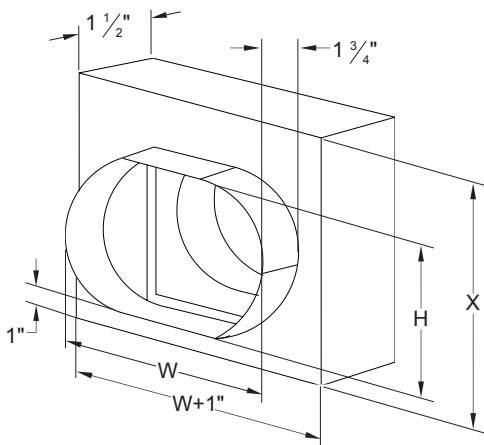

TYPE C
ROUND TRANSITION

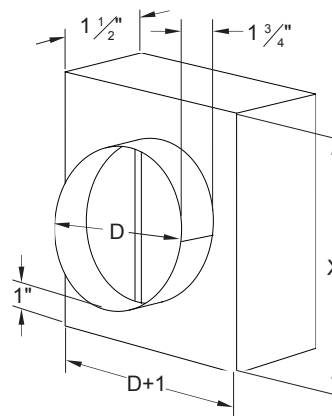

SUGGESTED INSTALLATION

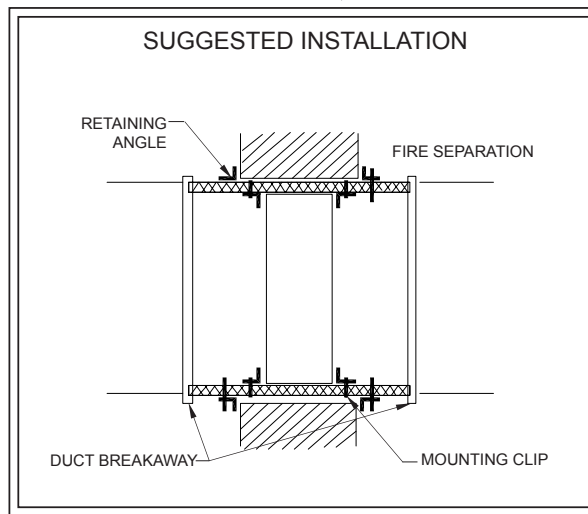

W = WIDTH (DUCT)

H = HEIGHT (DUCT)

D = DIAMETER

X = VARIABLE (SEE SIZE CHART)

NOTE: Independent tests have shown a need for fire dampers in some HVAC systems to close against air flow. UL tests at present evaluate the performance and reliability of fire dampers under static and dynamic conditions. We recommend Metal-Fab, Inc. U.L. Classified dynamic closure fire dampers in HVAC systems that involve the possibility of fire dampers having to close against air flow.

