



MODEL: MFDS3 SLIMFRAME CURTAIN-TYPE FIRE DAMPER 3-HOUR RATING

CLASSIFIED UL CLASSIFIED
(SEE COMPLETE MARKING ON PRODUCT)



3-HOUR RATING:

For use in fire barriers rated for 4 hours or less


STANDARD CONSTRUCTION:

- Frame:** Roll Formed 22 Ga. Galvanized Steel with Safety Edge. Width and height dimensions available in 1/4" increments
- Blades:** Roll Formed 24 Ga. Galvanized Steel, Curtain Type.
- Springs:** Stainless Steel.
- Transition:** 20 Ga. Galvanized Steel.
- Finish:** Mill Galvanized Standard.


OPTIONS:

- Type-A, Type-B or Type-C.
- Fuse Link 165°F, 212°F, 286°F.
- Vertical or Horizontal application.
- Sleeve options are 20 Ga., 18 Ga., or 16 Ga. and 12", 14" or 16" long.
- Low pressure, medium/high pressure or high pressure.
- Microswitch.

TYPICAL VERTICAL DAMPER

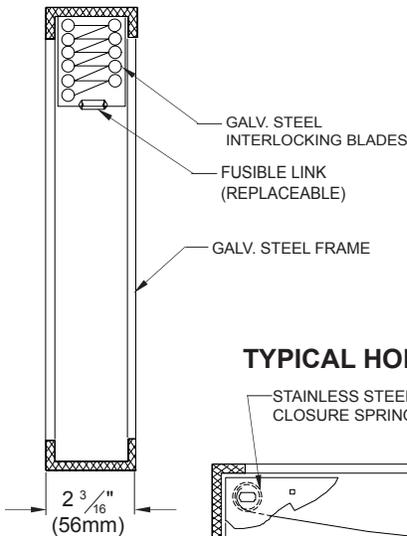

TYPICAL HORIZONTAL DAMPER

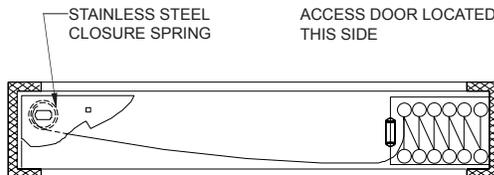


DUCT SIZE LIMITATIONS:

| | <u>MIN.</u> | <u>MAX. SINGLE SECTION</u> |
|--------------|-----------------|----------------------------|
| Vertical A | 4.25"W x 4.00"H | 48.25"W x 48.25"H |
| Vertical B | 4.25"W x 2.00"H | 48.25"W x 43.25"H |
| Vertical C | 5.25 DIA. | 47.25"W x 42.25"H |
| Horizontal A | 4.25"W x 4.00"H | 48.25"W x 48.25"H |
| Horizontal B | 4.25"W x 2.25"H | 48.25"W x 43.25"H |
| Horizontal C | 5.25 DIA. | 47.25"W x 42.25"H |


Project:
Location:
Architect:
Engineer:

Contractor:
Address:
P.O. Number:
Date:

MODEL STYLES

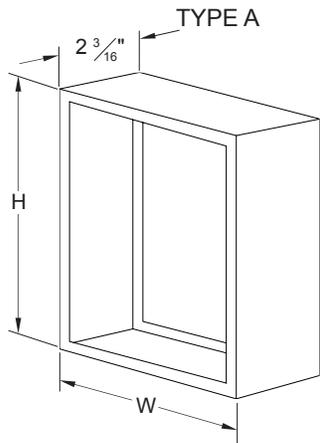


TYPE A

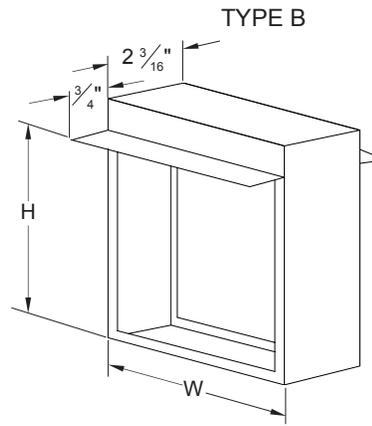


TYPE B


TYPE C
SQUARE TRANSITION

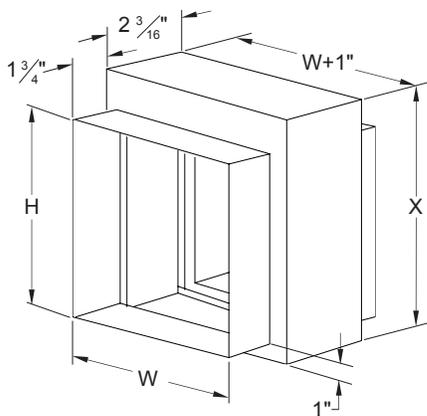


TYPE C
OVAL TRANSITION

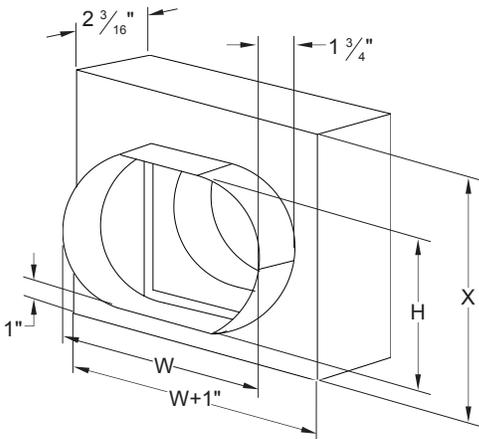

TYPE C
ROUND TRANSITION

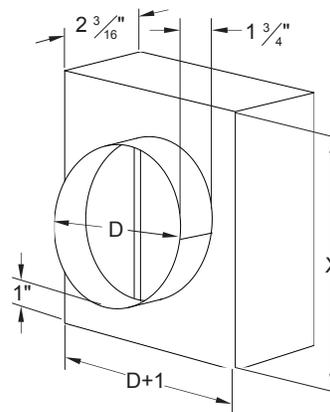

SUGGESTED INSTALLATION

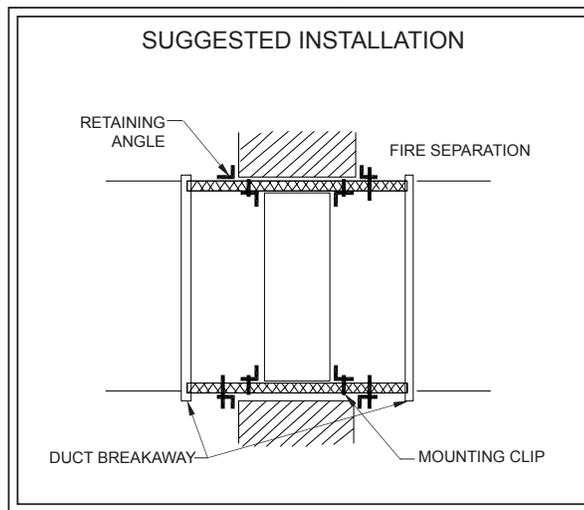

W = WIDTH (DUCT)

H = HEIGHT (DUCT)

D = DIAMETER

X = VARIABLE (SEE SIZE CHART)

NOTE: Independent tests have shown a need for fire dampers in some HVAC systems to close against air flow. UL tests at present evaluate the performance and reliability of fire dampers under static and dynamic conditions. We recommend Metal-Fab, Inc. U.L. Classified dynamic closure fire dampers in HVAC systems that involve the possibility of fire dampers having to close against air flow.

